



GROUNDING SYSTEM
FOR
PF-1 & PIR-2
SHEET 20

ATT. "H"

① can be routed in conduit
with associated power
feeders.

NOTE: ALL ground leads to
HAVE PVC COVERING.

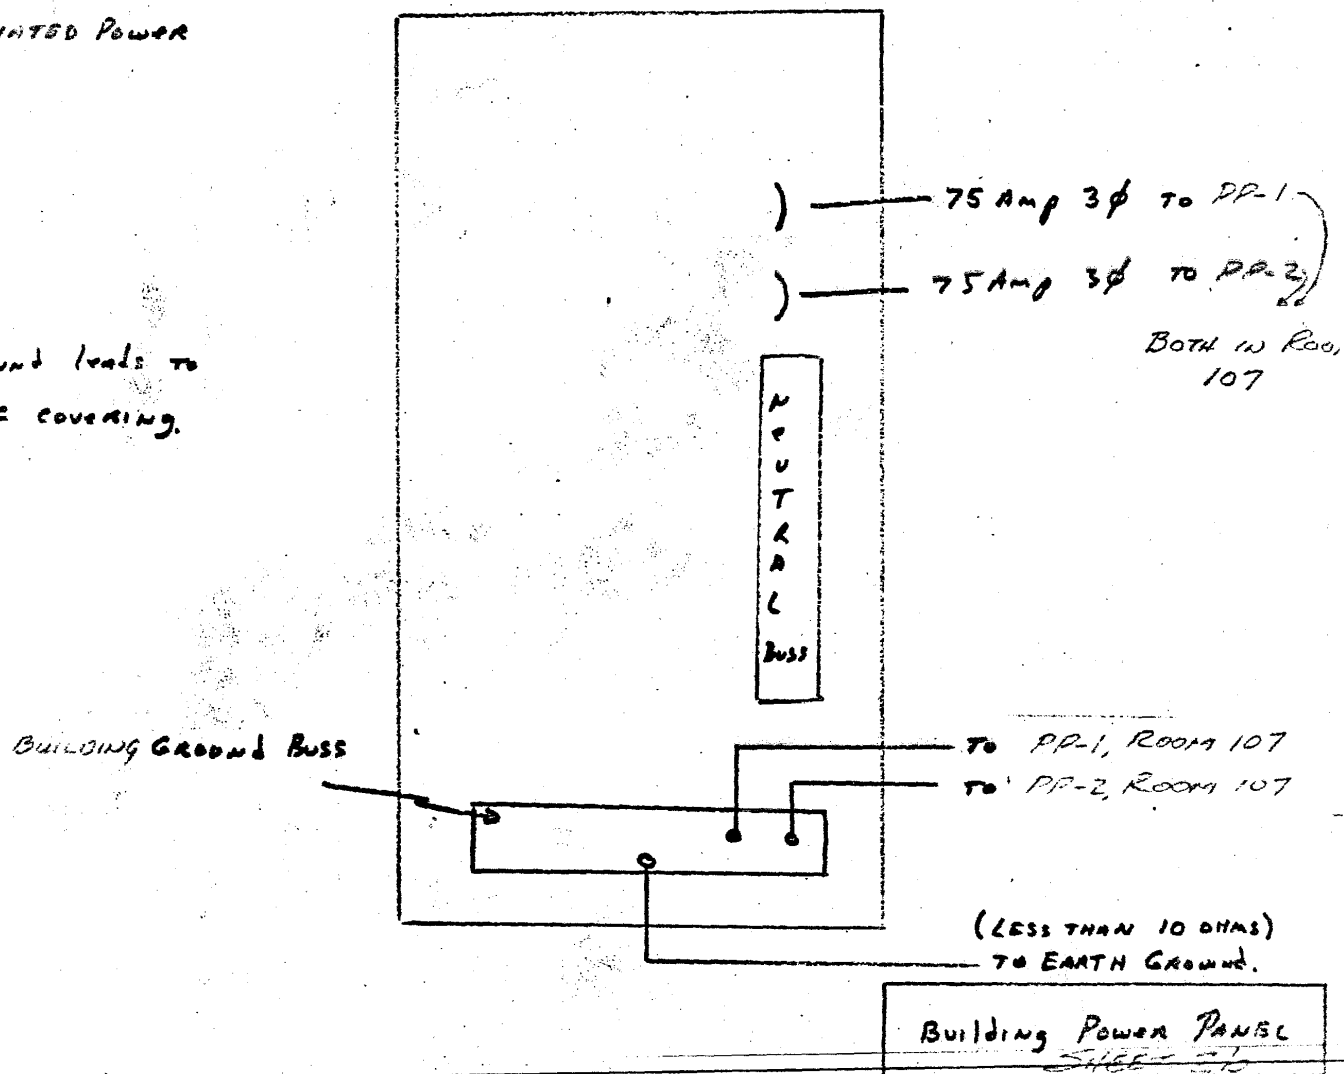

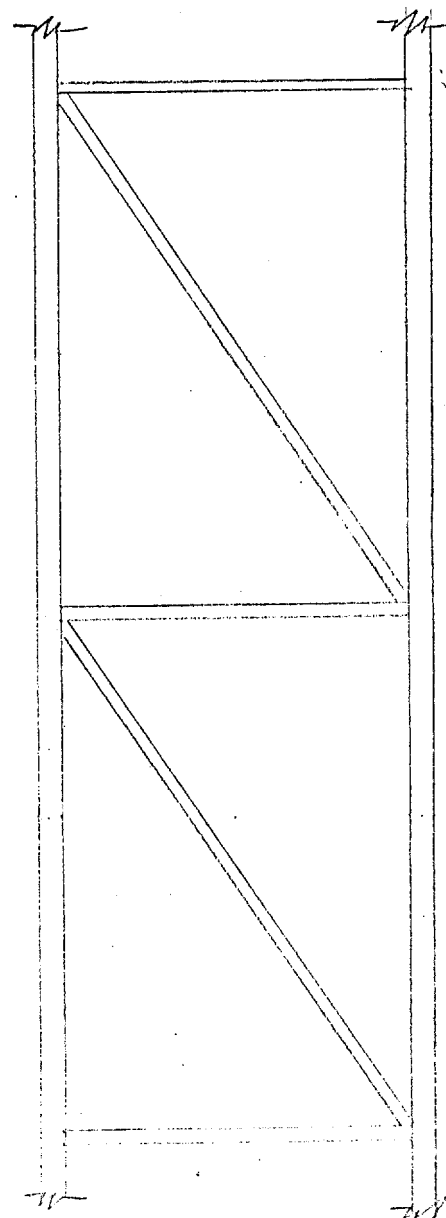$\frac{1}{2} \times \frac{1}{2}$ 

25X1B

Approved For Release 2001/08/07 : CIA-RDP78-06501A000300020023-1

Next 2 Page(s) In Document Exempt

Approved For Release 2001/08/07 : CIA-RDP78-06501A000300020023-1